# Thermal Conduction Vacuum Dryer (DPD-3) Maintenance

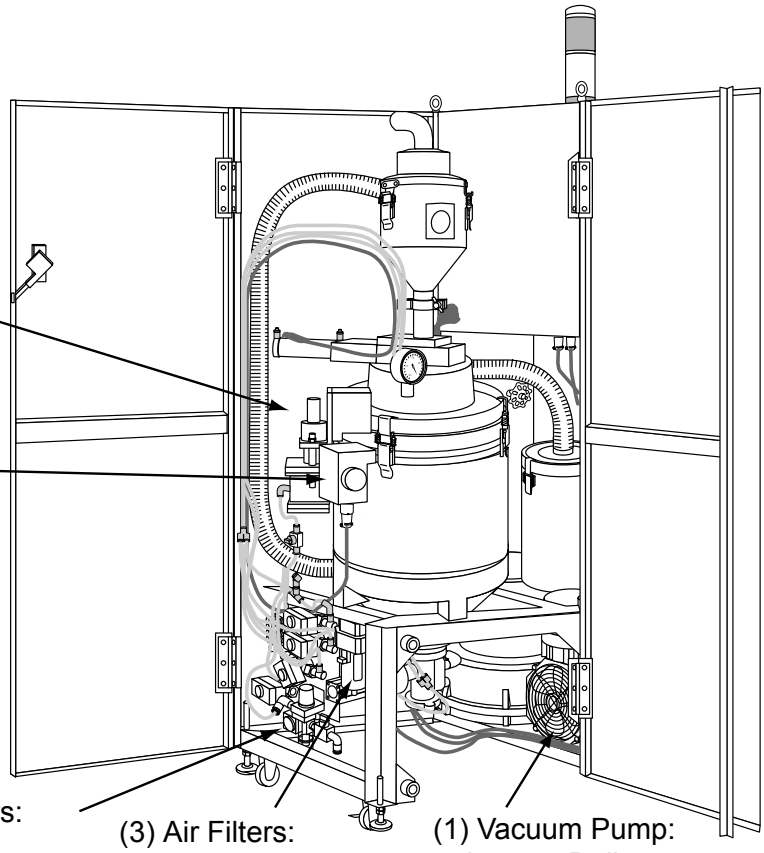

(7) Hood Unit Proximity Switch.
Inspect monthly

(11) Thermostat.
Inspect every three months

(2) Filter Regulators:
Clean weekly

(3) Air Filters:
Clean weekly

(1) Vacuum Pump:
Inspect Daily

(5) Hose, Band checks:
Check weekly

(8) Air Tube and Coulings:
Inspect monthly

(9) Auto Valves:
Inspect monthly

(12) Bolts, Nuts:
check every six months

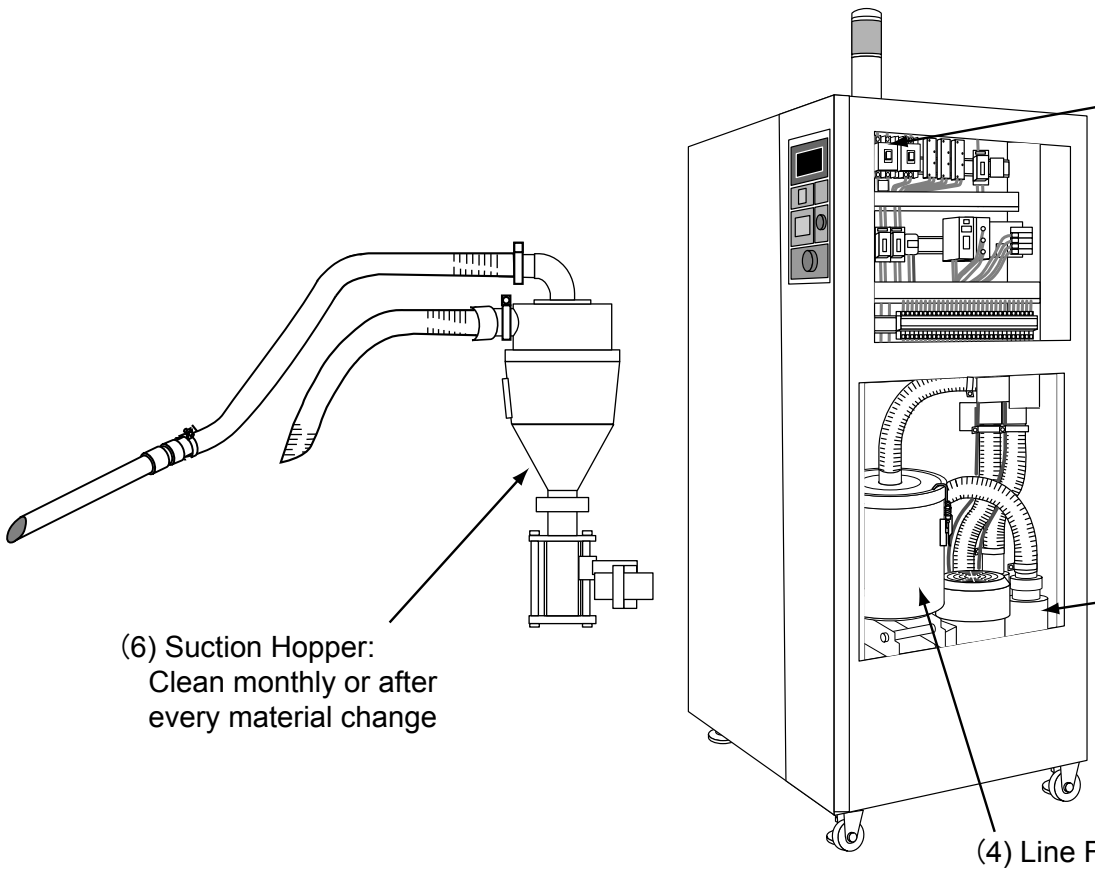

(10) Thermal Relay:
Inspect every Three months

(1) Convey Blower:
Inspect daily

(6) Suction Hopper:
Clean monthly or after every material change

(4) Line Filter (Filter Box), Cartridge Filter:
Clean weekly